




YES

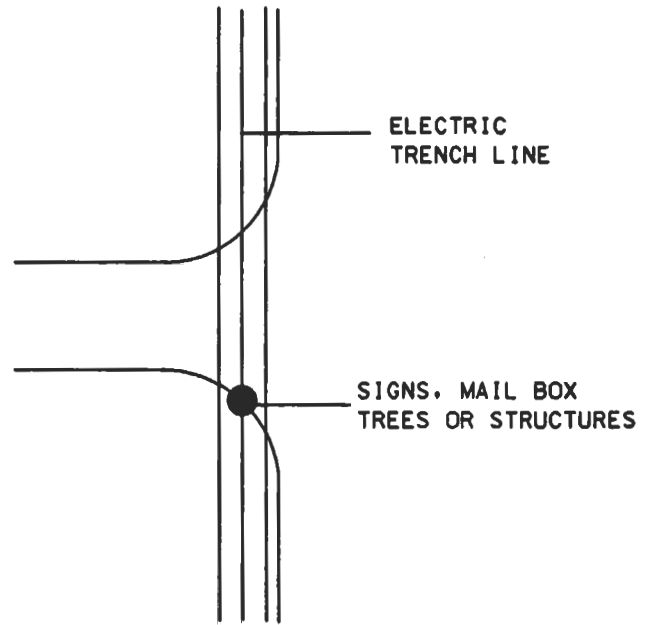

NO

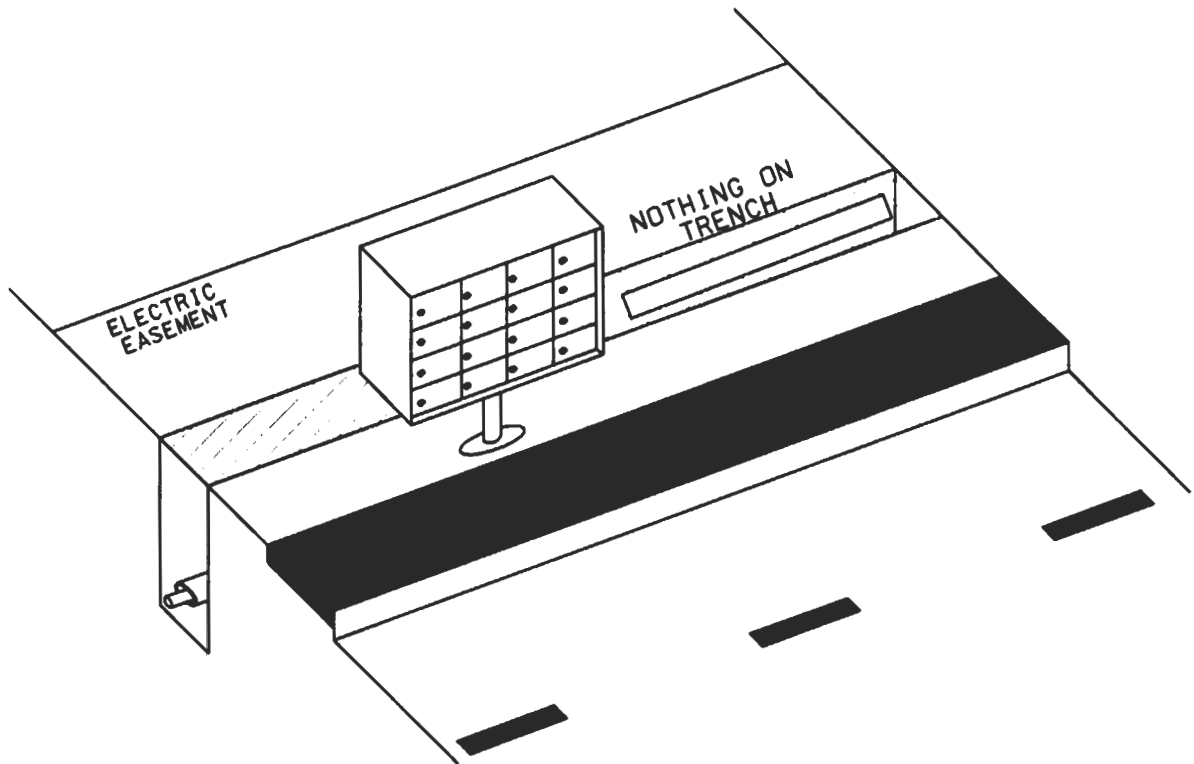

NOTE:  
CLEARANCES FROM EXISTING ELECTRIC UTILITY  
UNDERGROUND LINES MUST BE 3 FEET WHEN  
THE EXACT LOCATION HAS BEEN DETERMINED  
BY POT HOLING THE INFRASTRUCTURE

	CLEARANCES		
	REV.	700-02A	SCALE: NA
POWER & COMMUNICATIONS	DATE: DECEMBER 13, 2003	DRAWN BY: RAWMF	APPROVAL: